

检 验 报 告

TEST REPORT

NCSA-2021D-0047

中国认可
国际互认
检测
TESTING
CNAS L1045



产品名称:
Name of Product

镀锌钢板风管

委托单位:
Client

青岛亨通风管制造安装有限公司

生产单位:
Manufacture


青岛亨通风管制造安装有限公司

检验类别:
Test Category

委托检验

建科环能科技有限公司建筑环境与能源检测院
Testing Institute of Building Environment and Energy, Jianke EET Co., Ltd.
国家空调设备质量监督检验中心
National Center of Quality Supervision and Inspection and Testing for Air Conditioning Equipment



样品编号	2021D-0047				
产品名称	镀锌钢板风管		商 标	亨通	
委托单位	青岛亨通风管制造安装有限公司	出厂编号	HT21-4-668		
		生产日期	2021-04-12		
生产单位	青岛亨通风管制造安装有限公司	送样数量	1套		
		送样日期	2021-04-15		
检验类别	委托检验		检验日期	2021-04-18	
委托单位地址	青岛平度同和街道办事处衡阳路8号				
检验依据	JG/T258-2018《非金属及复合风管》				
判定依据	JG/T258-2018《非金属及复合风管》				
检验地点	北京市通州区葛渠富壁路				
检验用 仪器、装置	S16数字压力；S20漏风量测量装置；T-S137数字式精密气压表；T-S65大量程百分表；T-S66大量程百分表；T-S68钢卷尺；T-S76大量程百分表；T-S80数字温湿度计；T-S82数字压力表				
检验项目	单位面积漏风量（2000pa）、管壁变形量（2000pa）				
检 验 结 论	检验结果详见第2页 				

批准:  Approval: 

車核: Verification

可也

Chief tester

张金保




样品编号		2021D-0047			
检 验 结 果					
序号	检验项目	管内压力	标准要求	检验结果	分项判定
1	单位面积漏风量 [m ³ /(h·m ²)]	2000Pa	≤1.64 (C级矩形风管)	1.49	合格
2	管壁变形量 (%)	2000Pa	≤2.0 (C级风管)	0.58	合格

本页以下空白。



样品编号		2021D-0047		
样 品 描 述				
规格型号		3600×1500×500		类 型
风管尺寸 (mm)		3600×1500×500		
风管加固形式		纵向拉筋，每节3根；每节风管长1200mm，共3节		
风管连接形式		角钢法兰连接		
材 料		镀锌钢板、镀锌角钢		
生产日期		2021-04-12		
出厂编号		HT21-4-668		

备注：

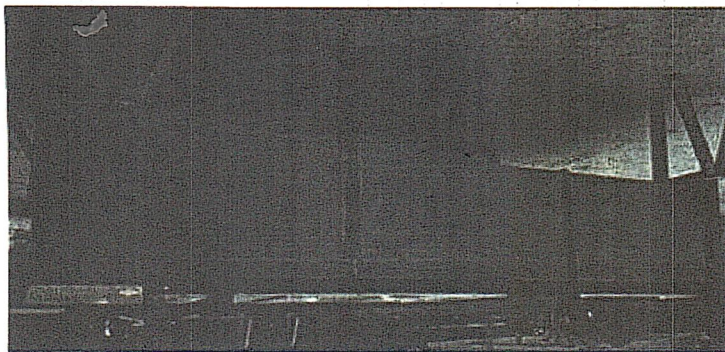

被测样品照片

本页以下空白。

注意 事项

NOTICE

1. 报告无“检验鉴定章”无效;
Test report is invalid without the "Stamp of test report" on it.
2. 复制报告未重新加盖“检验鉴定章”无效;
Duplication of test report is invalid without the "Stamp of test report" on it.
3. 报告无主检、审核、批准签字无效(仲裁检验报告应增加审定签字):
Test report is invalid without the signatures of the persons for chief test, verification and approval. The test report for arbitration should be added the signature of the person for verification on it.
4. 报告涂改无效;
Test report is invalid if altered.
5. 对检验报告若有异议,应于收到报告之日起十五日内向检验单位提出;
Different opinions about test report should be reported to the test department within 15 days from the date of receiving the test report.
6. 一般情况,委托检验仅对来样负责。
In general, for entrusted tests the responsibilities are undertaken for the delivered samples only.

地址: 北京市朝阳区安定门外小营路9号

Abb: No.9, Xiao Huang Zhuang Road, Gate of An Din Men, Chaoyang District, Beijing

业务电话 (Business TEL): 010-84274062 010-64517289

投诉电话 (Complain TEL): 010-64517653

传真 (FAX): 010-84274062

邮政编码 (Postcode): 100013

E-mail: facelc@ncsa.cn

Internet: http://www.ncsa.cn